



DISTRICT FIRE OFFICE
Karnataka Fire and Emergency Services
Tike Road, Vijayapur-586102

Karnataka State Fire & Emergency Services
Office of the District Fire Officer
Karnataka State Fire & Emergency Services
VIJAYAPUR Fire Station , VIJAYAPUR-586101
Telephone:08352-270160



C.NO.130/FSCR/DFO/VIJAYAPUR/2026

Date-27/03/2026

To,

The Head Master
Shri Gajanana Educational & Rural
Development Association Kanamadi
Tungal International School , Kanamadi
Sy.No.18 Plot No.06 Kanamadi Village
Tq-Tikota Dist- Vijayapur

Sub : Issue of '**Fire Safety Compliance Report**' for Shri Gajanana Educational & Rural Development Associations Kanamadi , "**Tungal International School Kanamadi**" Situated at Sy.No.18* Plot No.06 Kanamadi Village , Tq- Tikota, Dist- Vijayapur.

- Ref:1. NO:GBC(2)2100/2025 Date:03/02/2026
2. Applicants Letter Dt:- 25/03/2026
3. C.NO.137/FSR/DFO/VIJAYAPUR/2025 Date- 30/12/2025

>◇◇◇*@*◇◇◇<

With reference to the subject above cited, the premises of Shri Gajanana Educational & Rural Development Associations Kanamadi "**Tungal International School Kanamadi**" Situated at Sy.No.18* Plot No.06, Kanamadi Village, Tq- Tikota Dist- Vijayapur., was inspected by The District Fire Officer, Vijayapur on 27/03/2026 with respect to Fire prevention, Fire fighting and Evacuation measures to be complied in the above premises and the details as under.

ANNEXURE-1

(Up to 14.99 mtrs. In height)



"GROUP-B Educational Buildings

NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory.)

A. Details of the building / premises :-

01.	Name and Address of the Applicant.	:	The Secretary Shri Gajanana Educational & Rural Development Association Kanamadi Tungal International School , Kanamadi Tq-Tikota Dist- Vijayapur
	Name and Address of the premises.	:	The Head Master Shri Gajanana Educational & Rural Development Association Kanamadi Tungal International School , Kanamadi Situated at Sy.No.18* Plot No.06

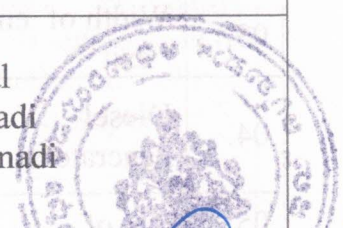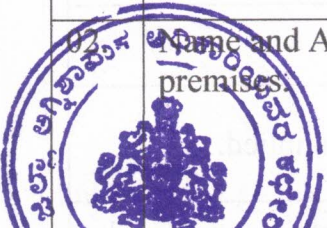


03.	Name and address of the Building owner	:	The Secretary Shri Gajanana Educational & Rural Development Association Kanamadi Tungal Internatinal School , Kanamadi Tq-Tikota Dist- Vijayapur
04.	Number of buildings	:	01 Building.
05.	Number of floors	:	G+3 floors (G+1 existing, 2 nd & 3 rd floors under construction)
07.	<u>Floor-wise details of occupancy:-</u>		
	Ground floor	:	Class rooms-12 nos , Chairman room, Director room, Meeting room, Lunch room.
	1 st Floor	:	Class rooms-12 nos , Chairman room, Director room, Meeting room, Lunch room. (Under construction & According to blue print)
	2 nd floor	:	(Under construction)
	3 rd floor	:	(Under construction)
08.	Height of the building	:	11.15 mtr
09.	Site area	:	8093.71 Sqmtr.
10.	Built-up area of each floor:-		
	Ground Floor	:	2228.89 Sq.mtr
	1 st Floor	:	2228.89 Sq.mtr
	2 nd Floor	:	2228.89 Sq.mtr
	3 rd floor	:	2228.89 Sq.mtr
11.	Total built-up area	:	8915.56 Sq.mtr
12.	Surrounding properties:-		
	East	:	Road
	West	:	Open Land
	North	:	Open Land
	South	:	Open Land
13.	<u>Set-back area available around the building :-</u>		
	East	:	50.00 mtr
	West	:	04.30 mtr
	North	:	08.30 mtr
	South	:	09.60 mtr

B. On inspection of this Institutional premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)
01.	Accessibility to the premises	The premises is accessible from 06.00 mtr wide road on the Eastern side.	Adequate
02.	No. of entrances	01 nos in the Eastern side.	-
03.	Width of entry	04.50 mtr	-
04.	Diesel generators	Provided one generator.	Complied.
05.	Nos. of staircases	03 no	The staircase must be

	staircases available	Width of staircases : 02.60 , 01.80 , 01.80 mtr	free from Obstruction all the time.
		Width of treads : 0.40 , 0.35 , 0.35 mtr	
		Height of risers : 0.15 mtr each	
		Nos. of riser per flight : 25 , 09 , 09 no's	
		Height of handrails : Nil	
06.	Fire extinguisher	Provided 16 no's of ABC Type Fire extinguishers Each 06.00 Kgs Capacity, & 02 no's of CO2 Type Fire eextinguishers Each 02.00 Kgs Capacity.	Complied
07.	Hose reel hose system	Four Hose reel hose near the staircase (One hose reel hose system for every 1000 sq.mtrs) has been provided. The hose reel hose of min 19 mm size and of 30 mtrs length has been provided to reach the farthest point of each floor and shut off branch having a nozzle of 05 mm size. The hose reel hose has been connected at each landing.	Complied
08.	Terrace Tank	The system should be connected to over head tank of 5000 ltrs capacity .	Complied
09.	At the terrace tank level with minimum pressure of 3.5 kg/cm ²	The system has been connected to the booster pump of 450 LPM capacity .	Complied
10.	Escape routes	Escape route has been marked with luminous light/paint at each floor directing towards exists and emergency exists .	Complied
11.	Fire order	A notice board indicating the action to be taken by the employees/students in case of any emergency has been displayed with the telephone numbers of Vijayapura Fire Station 08352-270160, 270101, 112 & 101, and the telephone nos nearest ambulance services and police station.	Complied
12.	No Smoking board	COPTA Sec-4 , smoking here is an offence board has been written & displayed in English & Kannada both languages .	Complied
13.	Fire Siren	Two Fire Siren has been installed in the premises to inform the inmates in case of a fire emergency and evacuate the area.	Complied
14.	Nominate One Fire Nodal Officer	Shri. Anand Guddapur & Shri. Subhash Biradar has been nominated as the Fire nodal officer.	Complied
15.	Fire fighting training	Shri. Anand Guddapur Shri. Subhash Biradar Shri. Ravi Hattikal Shri. Dondiba Pawar have undergone two days training at Fire Station Premises of Vijayapura on 13/03/2026 to 14/03/2026.	40% of employees shall be trained in basic fire fighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29,or Regional training centre hubballi or District Fire Station Vijayapur.

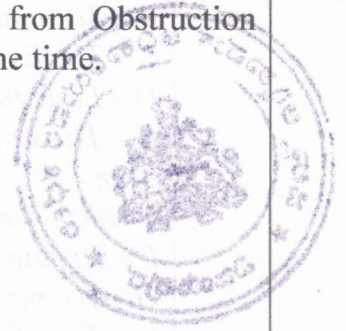

16. Precautionary Measures

Flammable and inflammable materials should not be stored in the store room, UPS room




- D. Accumulation of combustible waste in and around the premises should be avoided.
- E. Exit shall be always kept clear without any obstruction.
- D:- Liquefied petroleum gas should not be stored in the building.
- The doors shall not be kept locked/ latched during working hours and shall be free of obstruction.
- F. During the class hours the class room door shall not be locked from inside to out side.
- As per Honorable Supreme Court order all teachers and staff shall be trained to handle safety equipments, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordination with the fire services department.

Under the above circumstance the Karnataka Fire & Emergency Services Department is issuing of '**Fire Safety Compliance Report**' to Shri Gajanana Educational & Rural Development Associations Kanamadi , "**Tungal International School Kanamadi**" Situated at Sy.No.18* Plot No.06 Kanamadi Village , Tq- Tikota, Dist- Vijayapur. as they have complied all the recommendations.

This "**Fire Safety Compliance Report**" is valid for only one year from the date of issue.

Yours Faithfully


DISTRICT FIRE OFFICER
VIJAYAPUR-586108

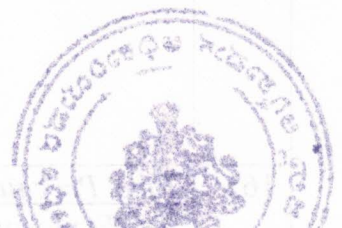

FIRE SAFETY CERTIFICATE

C.NO:130/FSCR/DFO/VJP/2026

Date : 27/03/2026

Certified that the **Shri Gajanana Educational & Rural Development Associations Kanamadi** " **Tungal International School Kanamadi**, Situated at Sy.No.18* Plot No.06, Kanamadi Village, Tq- Tikota Dist- Vijayapur Comprised of **Zero Basement, Ground & 1 Upper Floors** Owned/Occupied by **Tungal International School, Kanamadi Village** have complied with the fire prevention and fire safety requirements in accordance with rule of State/UT Fire Service Rules, and verified by the **District Fire Officer, Vijayapur** on **27/03/2026** in the presence of The Head Master, **Shri. K.Vinith**, and that the Building/Premises is fit for occupancy upto classes VIIIth with effect **from 27/03/2026 for a period of One Year** in accordance with rule and subject to compliance of specific conditions as appended:-

1. Maintenance of all fire fighting installations periodically



Issued on 27/03/2026 at Vijayapur, by


DISTRICT FIRE OFFICER
VIJAYAPUR-586108.....

Signature with Seal

Name

Designation

Name & Address

of Department/Office

VIJAYAPUR-586108.....

: S.S.Nilgar

: District Fire Officer

: Office of the District Fire Officer
Karnataka State Fire & Emergency
Services, Takke Road ,Vijayapur-
586108

To,
The Head Master
Shri Gajanana Educational & Rural
Development Association Kanamadi
Tungal Internatinal School , Kanamadi
Sy.No.18 Plot No.06 Kanamadi Village
Tq-Tikota Dist- Vijayapur

ENDORSEMENT

The No Objection Certificate issued by Fire Service stand cancelled an annulled due to

(Name and Designation of the authorized signatory)

The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with original vernacular certificate as a single pdf